



## LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:230.19V I:0.0753A P:9.0068W PF:0.5198 Freq:50.00Hz Lamp Flux:756.108x1 lm		
NAME: LED T8 TUBE	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: JIANG MEN MING WEI ELECTRIC CO.,LTD.	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 83.95 lm/W			
MODEL	081200264	Imax (cd)	157.0	S/MH (C0/180)	1.26
NOMINAL POWER(W)	--	LOR (%)	100.0	S/MH (C90/270)	1.44
RATED VOLTAGE (V)	--	TOTAL FLUX(lm)	756.11	$\eta$ UP,DN (C0-180)	9.1,41.0
NOMINAL FLUX(lm)	756.108	CIE CLASS	SEMI-D.	$\eta$ UP,DN (C180-360)	7.0,42.9
LAMPS INSIDE	1	$\eta$ up (%)	16.1	CIBSE SHR NOM	1.50
TEST VOLTAGE (V)	--	$\eta$ down (%)	83.9	CIBSE SHR MAX	1.55

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

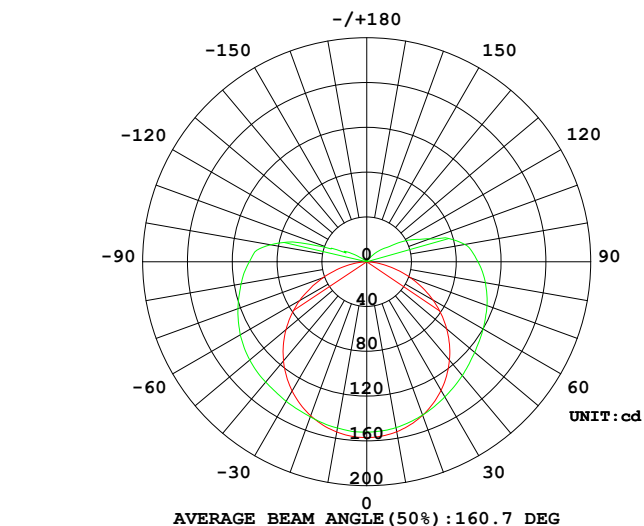

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

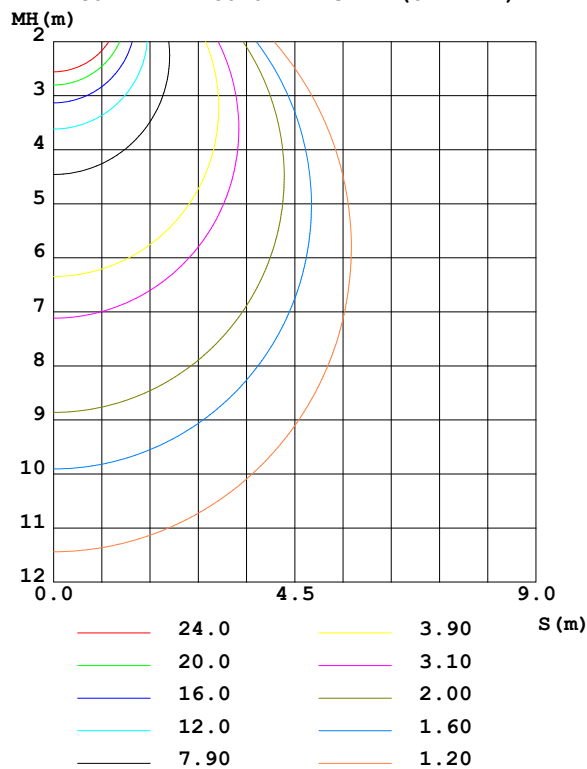

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: 10.0deg/s  
Temperature:25.3°C  
Operators:  
Test Date:2026-04-11

$\gamma$  Range: 0 - 180DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
Humidity:65.0%  
Test Distance:9.000m [K=1.0000]  
Remarks:

## ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

$\gamma$	C0	C45	C90	C135	C180	C225	C270	C315	$\gamma$	$\Phi$ zone	$\Phi$ total	%lum, lamp
10	154.1	151.4	150.4	149.8	154.4	151.8	150.7	150.0	0~ 10	14.54	14.54	1.92,1.92
20	145.9	144.7	145.7	143.4	146.4	146.0	147.4	144.3	10~ 20	41.99	56.53	7.48,7.48
30	132.6	134.8	139.4	133.7	133.3	137.1	143.9	135.6	20~ 30	65.02	121.5	16.1,16.1
40	114.9	122.5	132.7	121.6	115.6	127.2	140.3	125.9	30~ 40	81.85	203.4	26.9,26.9
50	93.15	109.3	125.8	108.6	94.10	116.4	136.4	115.6	40~ 50	91.67	295.1	39,39
60	68.23	96.05	120.0	95.72	69.24	105.6	130.3	105.0	50~ 60	94.45	389.5	51.5,51.5
70	41.31	84.85	114.3	84.74	41.26	92.75	122.4	92.45	60~ 70	90.78	480.3	63.5,63.5
80	15.36	75.36	107.5	75.48	15.57	80.35	113.9	80.19	70~ 80	82.24	562.5	74.4,74.4
90	0.6181	66.63	99.35	66.93	0.6814	70.81	104.8	70.76	80~ 90	71.97	634.5	83.9,83.9
100	0.5717	54.76	88.99	55.39	0.5520	47.15	87.30	49.16	90~100	60.91	695.4	92,92
110	0.7029	28.78	60.09	29.68	0.6674	9.833	33.76	10.87	100~110	37.14	732.6	96.9,96.9
120	0.8426	12.96	35.51	13.54	0.8240	1.141	13.62	1.080	110~120	14.50	747.1	98.8,98.8
130	0.9761	4.413	17.19	4.642	1.140	1.089	1.252	1.024	120~130	5.103	752.2	99.5,99.5
140	1.104	1.205	5.641	1.227	1.099	1.144	1.198	1.090	130~140	2.038	754.2	99.7,99.7
150	1.219	1.252	1.287	1.272	1.205	1.210	1.245	1.167	140~150	0.8052	755.0	99.9,99.9
160	1.321	1.309	1.304	1.328	1.315	1.285	1.271	1.239	150~160	0.5832	755.6	99.9,99.9
170	1.408	1.377	1.340	1.362	1.425	1.360	1.323	1.313	160~170	0.3747	756.0	100,100
180	1.428	1.378	1.368	1.351	1.452	1.381	1.373	1.348	170~180	0.1306	756.1	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 248.46 lm

%lum = 32.9%

%lamp = 32.9%

Conical surface Flux(120deg): 389.52 lm


%lum = 51.5%

%lamp = 51.5%

C Range: 0 - 360DEG  
 C Interval: 22.5DEG  
 Test Speed: 10.0deg/s  
 Temperature:25.3°C  
 Operators:  
 Test Date:2026-04-11

$\gamma$  Range: 0 - 180DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System:EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
 Humidity:65.0%  
 Test Distance:9.000m [K=1.0000]  
 Remarks:

LUMINANCE LIMITATION CURVES

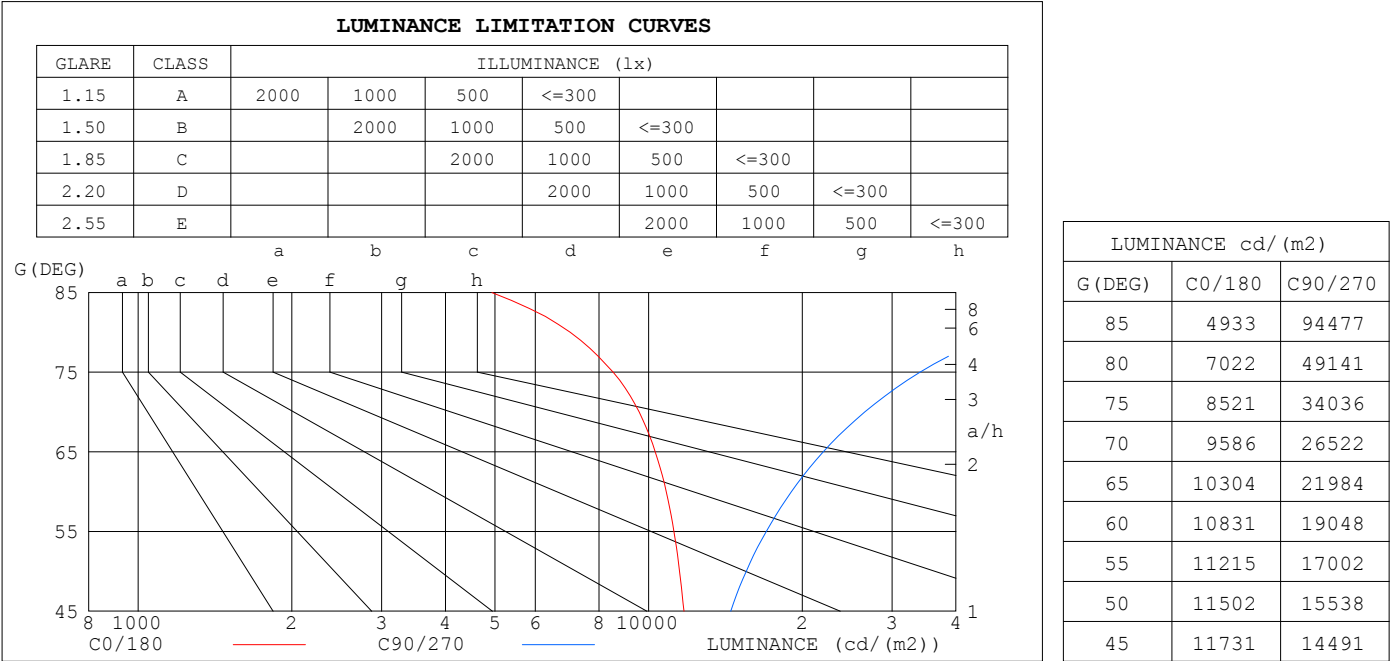


C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: 10.0deg/s  
Temperature:25.3°C  
Operators:  
Test Date:2026-04-11

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
Humidity:65.0%  
Test Distance:9.000m [K=1.0000]  
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)										
0.0	1.15	1.15	1.15	1.11	1.11	1.11	1.02	1.02	1.02	.94	.94	.94	.87	.87	.87	.84	
1.0	.95	.89	.84	.91	.85	.81	.83	.79	.75	.77	.73	.70	.70	.68	.65	.62	
2.0	.80	.72	.65	.77	.69	.63	.71	.64	.59	.65	.60	.55	.59	.55	.52	.48	
3.0	.69	.60	.52	.67	.58	.51	.61	.54	.48	.56	.50	.45	.51	.47	.42	.39	
4.0	.61	.51	.43	.58	.49	.42	.54	.46	.40	.49	.43	.38	.45	.40	.35	.33	
5.0	.54	.44	.37	.52	.43	.36	.48	.40	.34	.44	.37	.32	.40	.35	.30	.28	
6.0	.48	.39	.32	.46	.37	.31	.43	.35	.29	.40	.33	.28	.36	.31	.26	.24	
7.0	.43	.34	.28	.42	.33	.27	.39	.31	.26	.36	.29	.24	.33	.27	.23	.21	
8.0	.39	.30	.24	.38	.30	.24	.35	.28	.23	.33	.26	.22	.30	.25	.20	.18	
9.0	.36	.27	.22	.35	.27	.21	.32	.25	.20	.30	.24	.19	.28	.22	.18	.16	
10.0	.33	.25	.19	.32	.24	.19	.30	.23	.18	.28	.22	.17	.26	.21	.17	.15	

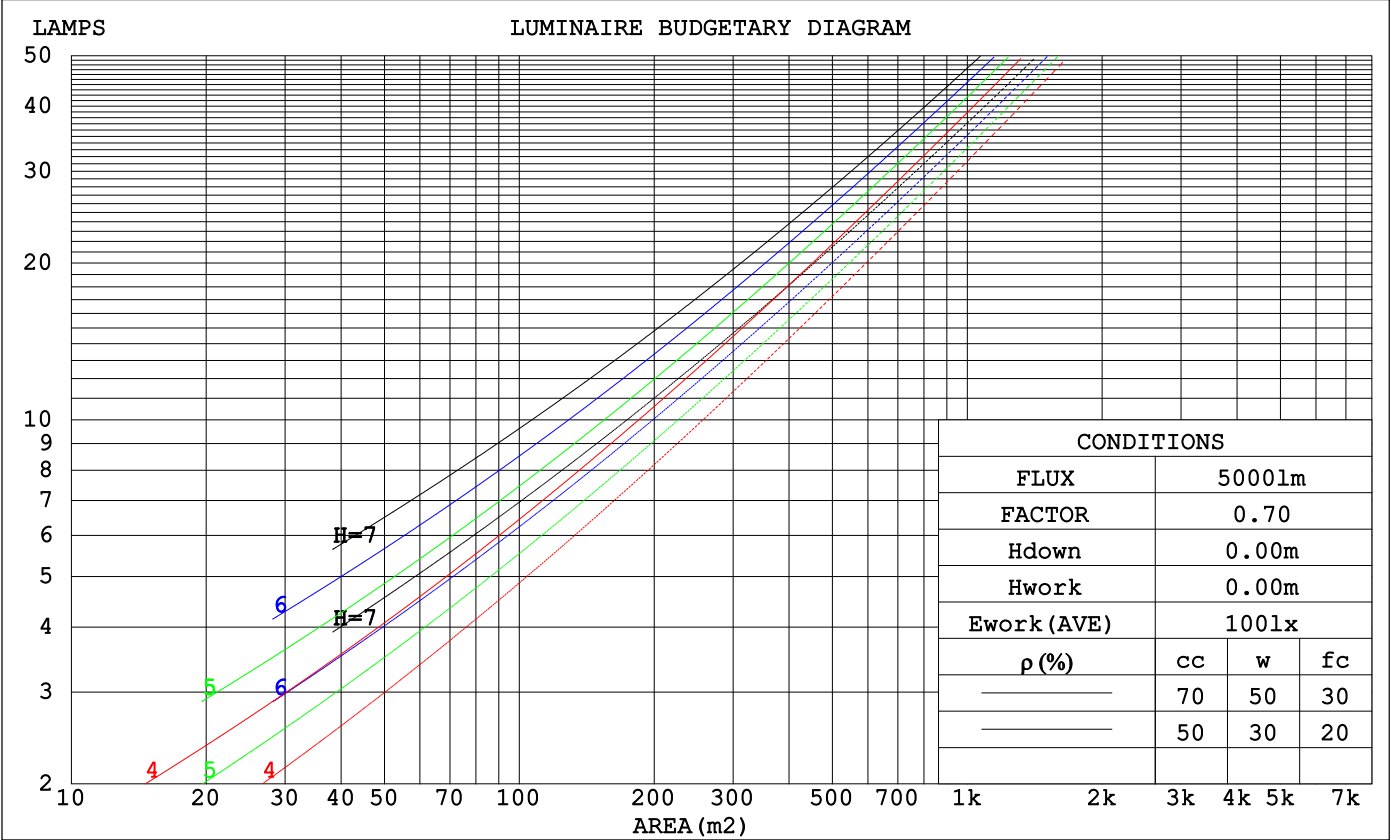

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: 10.0deg/s  
Temperature:25.3℃  
Operators:  
Test Date:2026-04-11

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
Humidity:65.0%  
Test Distance:9.000m [K=1.0000]  
Remarks:

## WEC AND CCEC

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)										
0.0																	
1.0	.415	.236	.075	.402	.230	.073	.380	.218	.070	.359	.207	.066	.339	.197	.063		
2.0	.352	.193	.059	.341	.188	.058	.320	.178	.055	.301	.169	.053	.283	.160	.051		
3.0	.309	.164	.049	.299	.160	.048	.280	.152	.046	.263	.144	.044	.247	.137	.042		
4.0	.276	.143	.042	.267	.140	.041	.250	.133	.040	.234	.126	.038	.220	.119	.036		
5.0	.250	.127	.037	.241	.124	.036	.226	.118	.035	.212	.112	.033	.199	.106	.032		
6.0	.228	.114	.033	.220	.111	.032	.206	.106	.031	.193	.101	.030	.181	.095	.028		
7.0	.209	.104	.029	.203	.101	.029	.190	.096	.028	.178	.091	.027	.167	.087	.025		
8.0	.194	.095	.027	.188	.092	.026	.176	.088	.025	.165	.084	.024	.155	.079	.023		
9.0	.180	.087	.024	.175	.085	.024	.164	.081	.023	.154	.077	.022	.144	.073	.021		
10.0	.168	.081	.022	.163	.079	.022	.153	.075	.021	.144	.072	.020	.135	.068	.020		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.313	.313	.313	.268	.268	.268	.183	.183	.183	.105	.105	.105	.034	.034	.034		
1.0	.311	.279	.250	.266	.239	.215	.182	.165	.149	.105	.095	.086	.034	.031	.028		
2.0	.305	.256	.215	.261	.220	.186	.179	.152	.130	.103	.089	.076	.033	.029	.025		
3.0	.297	.240	.194	.255	.207	.168	.175	.144	.118	.101	.084	.069	.032	.027	.023		
4.0	.289	.227	.180	.248	.196	.156	.171	.137	.110	.099	.080	.065	.032	.026	.021		
5.0	.281	.217	.170	.241	.188	.148	.166	.131	.105	.096	.077	.062	.031	.025	.020		
6.0	.273	.209	.164	.235	.181	.142	.162	.127	.101	.094	.075	.060	.030	.024	.020		
7.0	.266	.203	.158	.229	.176	.138	.158	.123	.098	.092	.073	.058	.030	.024	.019		
8.0	.259	.197	.155	.223	.171	.135	.154	.120	.096	.090	.071	.057	.029	.023	.019		
9.0	.253	.192	.152	.218	.167	.132	.151	.117	.094	.088	.069	.056	.028	.023	.019		
10.0	.247	.188	.149	.213	.163	.130	.148	.115	.093	.086	.068	.055	.028	.022	.018		

C Range: 0 - 360DEG  
 C Interval: 22.5DEG  
 Test Speed: 10.0deg/s  
 Temperature:25.3°C  
 Operators:  
 Test Date:2026-04-11

γ Range: 0 - 180DEG  
 γ Interval: 1.0DEG  
 Test System:EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
 Humidity:65.0%  
 Test Distance:9.000m [K=1.0000]  
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	19.7	21.1	20.2	21.6	22.2	22.1	23.5	22.6	24.0	24.5
3H	21.2	22.6	21.8	23.1	23.7	25.1	26.4	25.6	27.0	27.5
4H	21.9	23.1	22.4	23.7	24.3	26.8	28.1	27.4	28.6	29.2
6H	22.3	23.5	22.9	24.1	24.7	28.7	29.9	29.3	30.5	31.1
8H	22.4	23.6	23.0	24.2	24.8	29.8	31.0	30.4	31.5	32.2
12H	22.5	23.6	23.1	24.2	24.9	31.0	32.2	31.6	32.7	33.4
4H 2H	21.0	22.2	21.5	22.8	23.4	22.7	23.9	23.2	24.5	25.1
3H	22.8	23.9	23.4	24.5	25.1	26.0	27.1	26.5	27.6	28.3
4H	23.6	24.6	24.2	25.2	25.9	27.9	28.9	28.5	29.5	30.2
6H	24.3	25.2	24.9	25.8	26.5	30.0	31.0	30.7	31.6	32.3
8H	24.5	25.4	25.2	26.0	26.8	31.2	32.1	31.9	32.7	33.5
12H	24.7	25.5	25.4	26.2	26.9	32.6	33.4	33.2	34.1	34.8
8H 4H	25.0	25.9	25.6	26.5	27.2	28.3	29.1	28.9	29.8	30.5
6H	26.1	26.9	26.8	27.5	28.3	30.7	31.5	31.4	32.1	32.9
8H	26.6	27.3	27.3	28.0	28.7	32.2	32.8	32.8	33.5	34.3
12H	27.0	27.6	27.7	28.3	29.1	33.8	34.4	34.5	35.1	35.9
12H 4H	25.5	26.3	26.1	27.0	27.7	28.3	29.1	28.9	29.7	30.5
6H	26.9	27.6	27.6	28.3	29.1	30.9	31.5	31.5	32.2	33.0
8H	27.6	28.2	28.3	28.9	29.7	32.4	33.0	33.1	33.7	34.5
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.1 / - 0.1					+ 0.1 / - 0.1				
1.5H	+ 0.2 / - 0.2					+ 0.2 / - 0.3				
2.0H	+ 0.2 / - 0.4					+ 0.3 / - 0.4				

CIE Pub.117, 756.1 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -1.0)  
Area: 0.0126 m2

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: 10.0deg/s  
Temperature:25.3°C  
Operators:  
Test Date:2026-04-11

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
Humidity:65.0%  
Test Distance:9.000m [K=1.0000]  
Remarks:


## UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	47	34	27	46	34	26	44	33	26	19
0.80	56	42	34	54	42	34	52	40	33	25
1.00	63	50	41	62	49	41	58	50	40	31
1.25	70	57	48	68	56	47	64	53	46	37
1.50	75	62	53	73	61	52	68	58	51	41
2.00	83	71	62	80	69	61	74	65	58	47
2.50	87	76	68	84	74	66	78	70	63	51
3.00	91	81	73	88	78	71	81	74	68	55
4.00	96	87	80	92	84	78	85	79	74	60
5.00	99	91	85	95	88	82	88	83	78	63
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
 C Interval: 22.5DEG  
 Test Speed: 10.0deg/s  
 Temperature: 25.3°C  
 Operators:  
 Test Date: 2026-04-11

γ Range: 0 - 180DEG  
 γ Interval: 1.0DEG  
 Test System: EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
 Humidity: 65.0%  
 Test Distance: 9.000m [K=1.0000]  
 Remarks:

## ISOCANDELA DIAGRAM

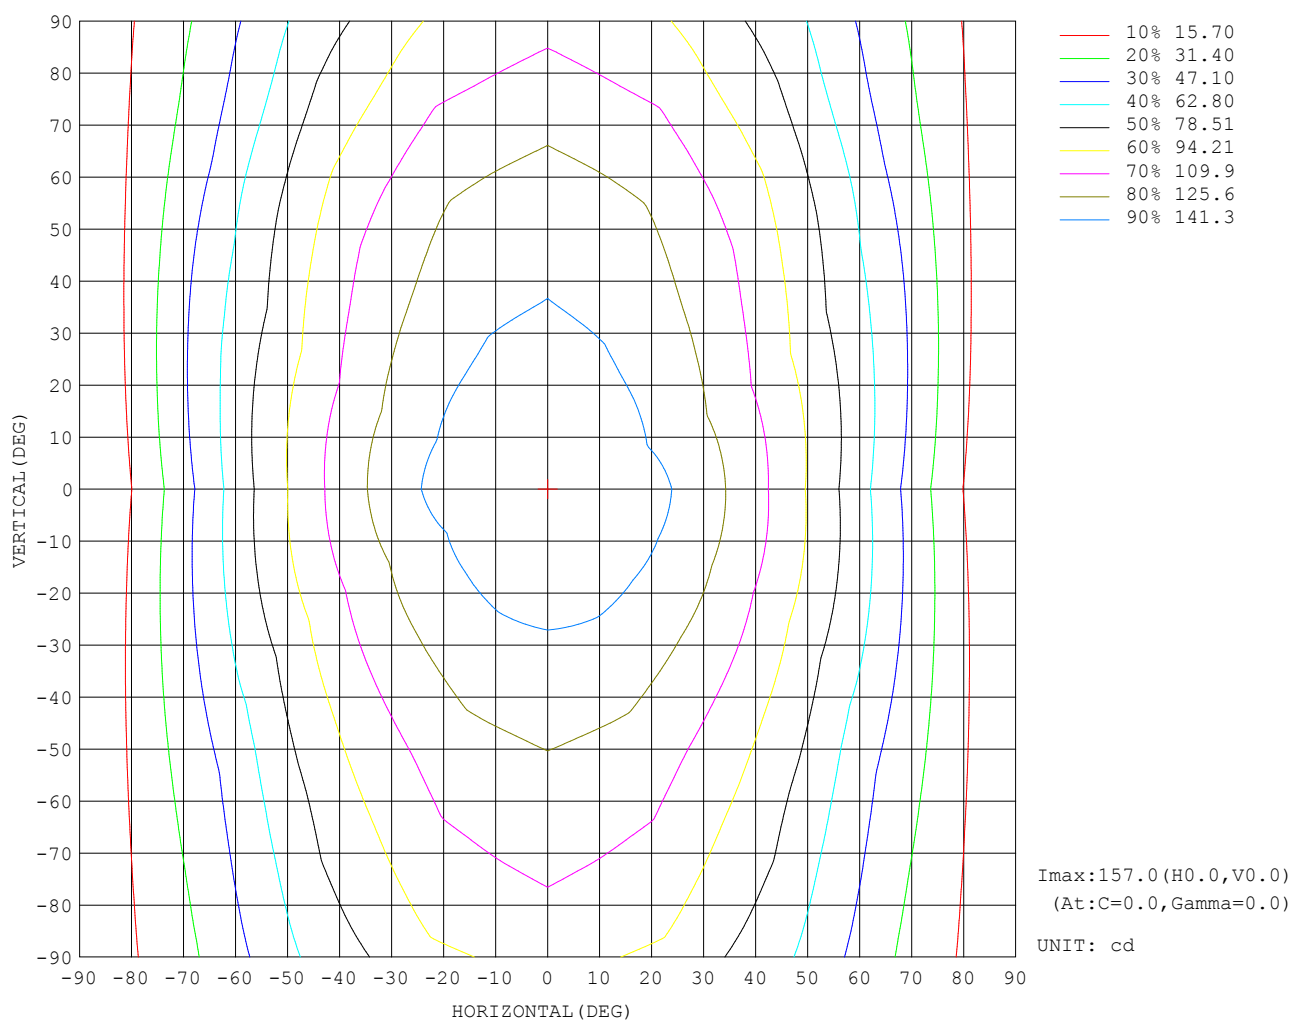


C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: 10.0deg/s  
Temperature: 25.3°C  
Operators:  
Test Date: 2026-04-11

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System: EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
Humidity: 65.0%  
Test Distance: 9.000m [K=1.0000]  
Remarks:



## AAI Figure

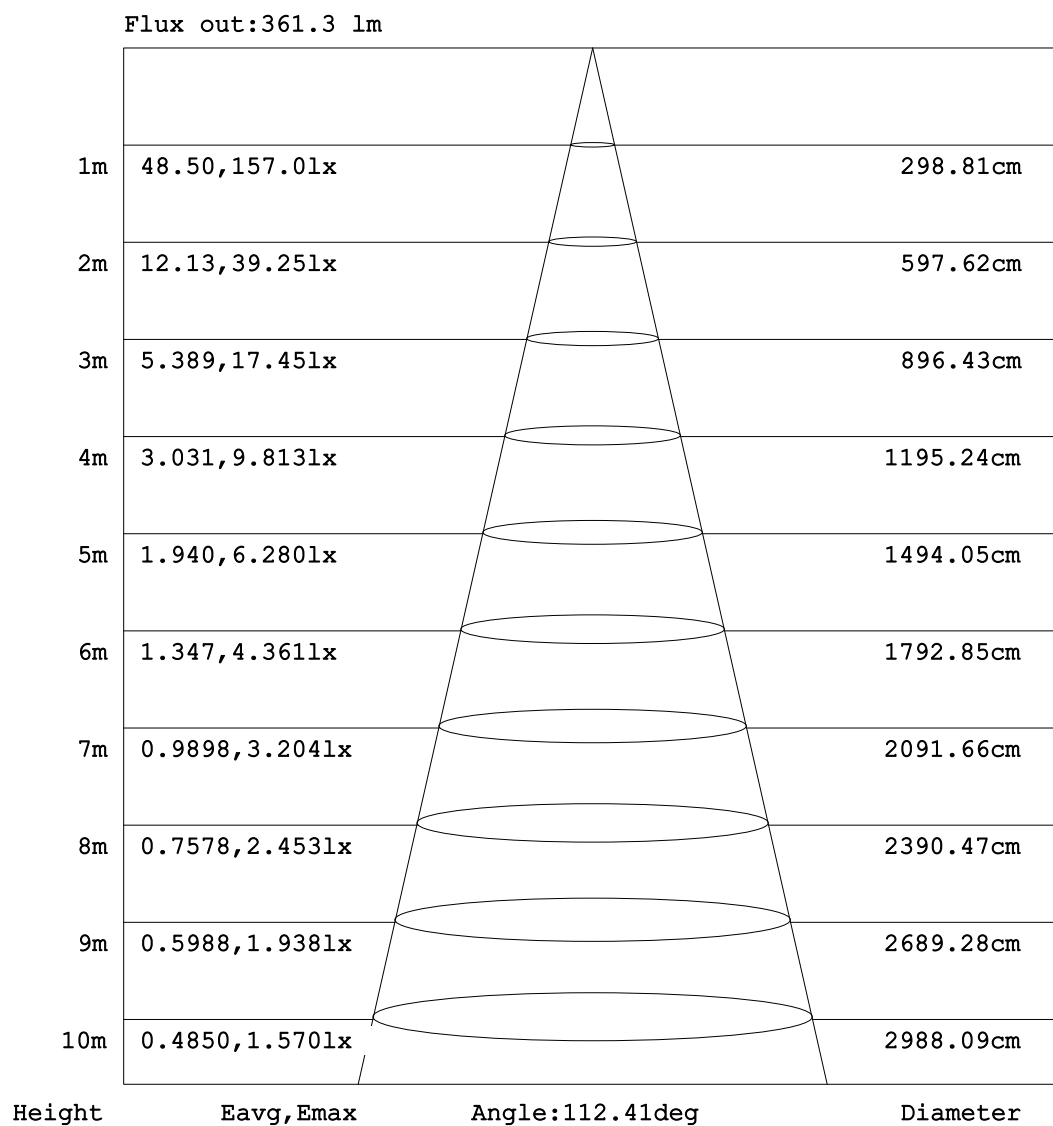


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
 C Interval: 22.5DEG  
 Test Speed: 10.0deg/s  
 Temperature: 25.3°C  
 Operators:  
 Test Date: 2026-04-11

γ Range: 0 - 180DEG  
 γ Interval: 1.0DEG  
 Test System: EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
 Humidity: 65.0%  
 Test Distance: 9.000m [K=1.0000]  
 Remarks:

## ISOLUX DIAGRAM

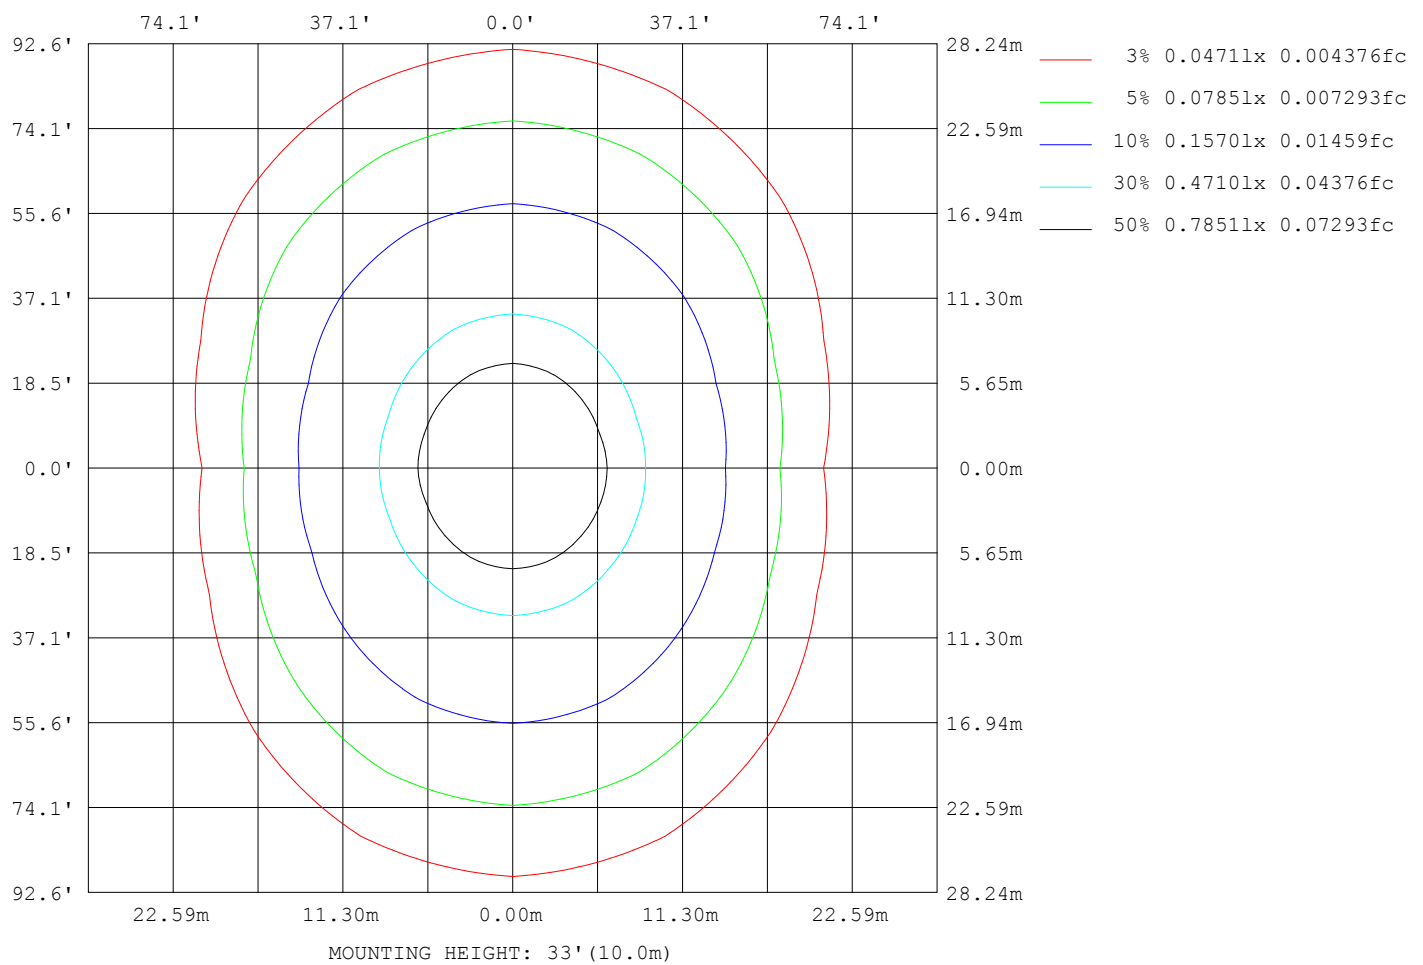

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: 10.0deg/s  
Temperature: 25.3°C  
Operators:  
Test Date: 2026-04-11

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System: EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
Humidity: 65.0%  
Test Distance: 9.000m [K=1.0000]  
Remarks:

## LED Avg.L Report

Test:U:230.19V I:0.0753A P:9.0068W PF:0.5198 Freq:50.00Hz Lamp Flux:756.108x1 lm		
NAME: LED T8 TUBE	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: JIANG MEN MING WEI ELECTRIC CO.,LTD.	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	10293
L_0~180 (75) av	8547
L_0~180 (85) av	4987
L_90~270 (65) av	22863
L_90~270 (75) av	35133
L_90~270 (85) av	97190
L_45 (65) av	17782
L_45 (75) av	25487
L_45 (85) av	66749

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: 10.0deg/s  
Temperature:25.3℃  
Operators:  
Test Date:2026-04-11

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
Humidity:65.0%  
Test Distance:9.000m [K=1.0000]  
Remarks:

## Planar Illuminance Curve

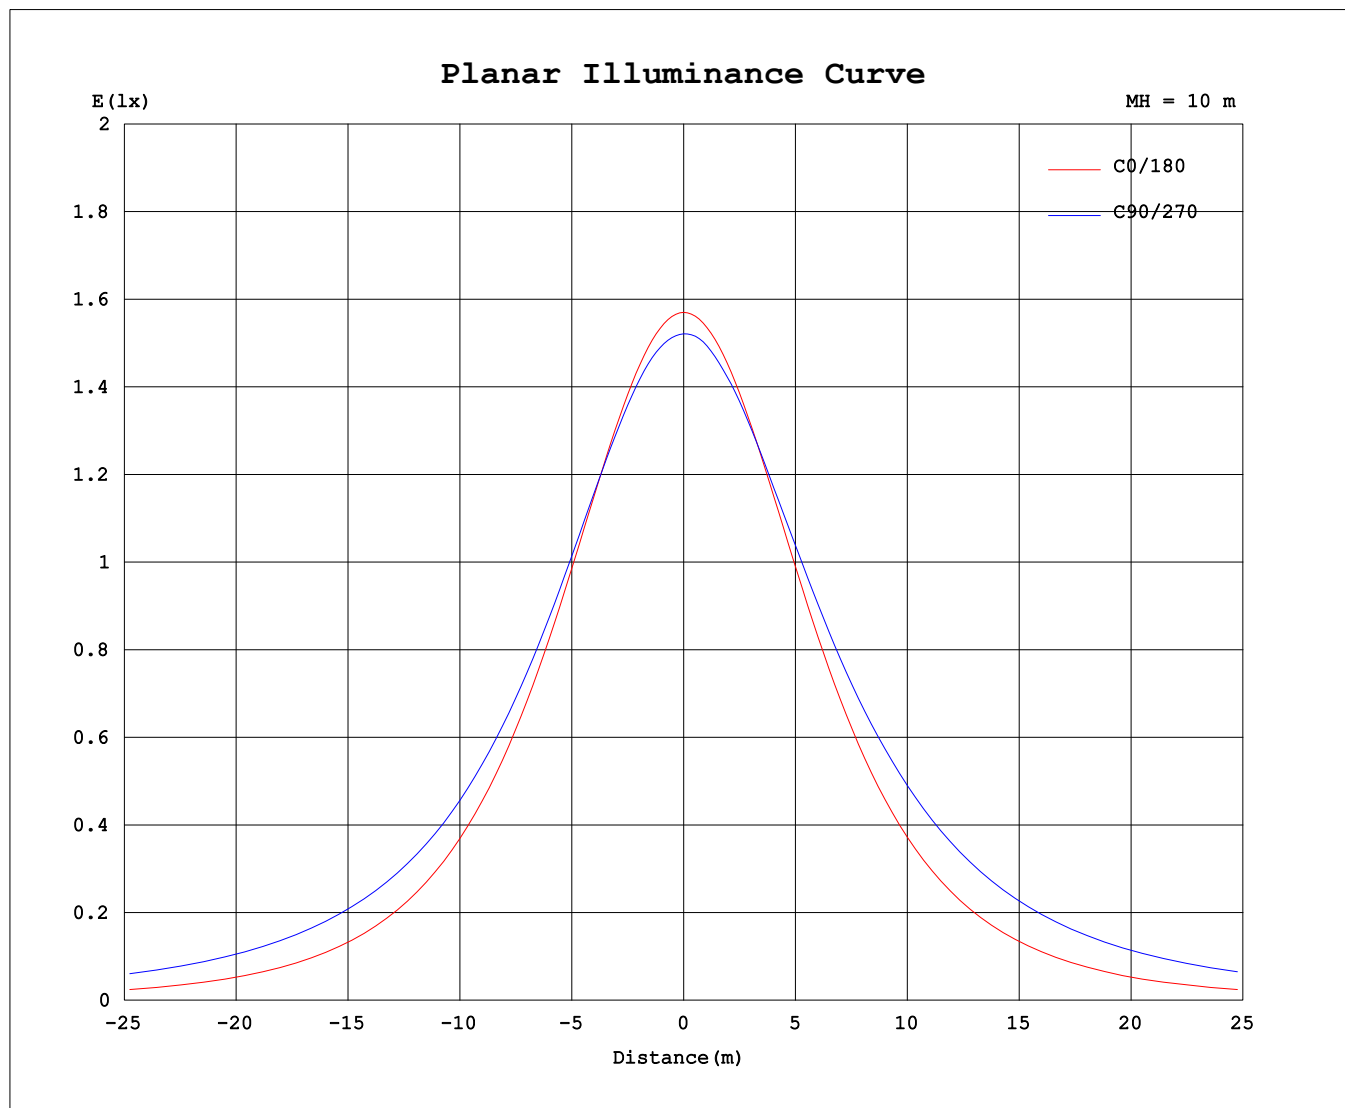

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: 10.0deg/s  
Temperature: 25.3°C  
Operators:  
Test Date: 2026-04-11

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System: EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
Humidity: 65.0%  
Test Distance: 9.000m [K=1.0000]  
Remarks:

## LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	157	155	154	153	152	152	152	152	157	155	154	153	152	152	152	152			
5	156	154	153	152	152	151	151	151	156	154	153	153	152	152	152	152			
10	154	152	151	151	150	150	150	150	154	152	152	151	151	150	150	150			
15	151	149	149	149	148	148	147	147	151	149	149	150	149	149	147	147			
20	146	145	145	146	146	145	143	142	146	145	146	147	147	146	144	142			
25	140	139	140	142	143	142	139	137	140	139	142	144	146	144	140	137			
30	133	133	135	138	139	138	134	130	133	133	137	142	144	141	136	131			
35	124	125	129	134	136	134	128	123	125	125	132	139	142	139	131	123			
40	115	116	123	130	133	130	122	115	116	117	127	136	140	136	126	115			
45	105	107	116	126	129	125	115	106	105	108	122	134	139	134	121	107			
50	93.2	97.4	109	121	126	121	109	96.1	94.1	99.1	116	131	136	131	116	97.7			
55	81.0	87.2	102	117	123	117	102	86.2	82.0	89.8	111	128	134	127	111	88.7			
60	68.2	76.8	96.0	114	120	114	95.7	76.0	69.2	80.4	106	123	130	123	105	79.5			
65	54.9	66.6	90.3	110	117	110	90.1	66.0	54.7	71.5	99.4	119	126	119	99.0	70.9			
70	41.3	55.5	84.8	107	114	107	84.7	55.2	41.3	63.1	92.8	114	122	114	92.4	62.7			
75	27.8	46.9	80.0	103	111	103	80.0	46.8	28.0	53.8	86.3	110	118	109	86.1	54.0			
80	15.4	39.8	75.4	99.4	108	99.4	75.5	39.9	15.6	44.2	80.3	105	114	105	80.2	44.5			
85	5.42	34.3	71.1	95.5	104	95.5	71.3	34.5	5.54	37.0	75.5	101	110	100	75.4	37.3			
90	0.62	30.3	66.6	91.1	99.4	91.1	66.9	30.6	0.68	32.7	70.8	95.7	105	95.6	70.8	33.3			
95	0.54	26.0	62.8	86.8	95.0	86.9	63.2	26.5	0.54	24.4	65.4	90.5	100	91.2	65.5	25.4			
100	0.57	17.1	54.8	80.6	89.0	80.7	55.4	18.1	0.55	8.22	47.2	74.8	87.3	76.9	49.2	9.27			
105	0.63	7.53	44.0	69.9	78.2	70.2	45.0	7.90	0.60	1.50	26.0	57.7	68.6	58.7	27.8	1.66			
110	0.70	4.82	28.8	55.0	60.1	54.6	29.7	4.91	0.67	0.86	9.83	30.5	33.8	27.9	10.9	0.81			
115	0.77	2.24	17.9	38.7	47.2	40.2	18.8	2.26	0.75	0.85	4.60	12.1	22.4	16.9	4.84	0.79			
120	0.84	0.94	13.0	27.3	35.5	25.3	13.5	0.96	0.82	0.88	1.14	8.53	13.6	8.41	1.08	0.82			
125	0.91	0.99	8.77	13.8	22.7	12.3	9.11	1.00	0.90	0.93	1.09	1.33	4.07	1.26	1.03	0.87			
130	0.98	1.03	4.41	9.73	17.2	10.4	4.64	1.05	1.14	0.99	1.09	1.23	1.25	1.19	1.02	0.93			
135	1.04	1.09	1.21	7.25	11.5	7.34	1.24	1.10	1.28	1.18	1.20	1.21	1.22	1.17	1.07	1.06			
140	1.10	1.15	1.20	2.97	5.64	2.94	1.23	1.14	1.10	1.09	1.14	1.20	1.20	1.17	1.09	1.04			
145	1.17	1.19	1.23	1.29	1.30	1.31	1.25	1.19	1.15	1.13	1.17	1.22	1.22	1.19	1.13	1.09			
150	1.22	1.23	1.25	1.30	1.29	1.31	1.27	1.23	1.21	1.17	1.21	1.24	1.25	1.21	1.17	1.14			
155	1.27	1.28	1.28	1.31	1.29	1.32	1.30	1.25	1.26	1.22	1.25	1.27	1.26	1.24	1.20	1.19			
160	1.32	1.32	1.31	1.32	1.30	1.33	1.33	1.29	1.31	1.27	1.29	1.29	1.27	1.26	1.24	1.24			
165	1.36	1.35	1.34	1.34	1.32	1.35	1.35	1.32	1.37	1.31	1.32	1.32	1.30	1.28	1.28	1.29			
170	1.41	1.39	1.38	1.35	1.34	1.36	1.36	1.35	1.42	1.36	1.36	1.36	1.32	1.31	1.31	1.33			
175	1.44	1.41	1.39	1.38	1.36	1.37	1.36	1.36	1.44	1.37	1.37	1.37	1.35	1.33	1.33	1.35			
180	1.43	1.39	1.38	1.38	1.37	1.35	1.35	1.35	1.45	1.38	1.38	1.37	1.37	1.35	1.35	1.35			

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: 10.0deg/s  
Temperature:25.3℃  
Operators:  
Test Date:2026-04-11

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-3000H\_V1 SYSTEM V2.00.463  
Humidity:65.0%  
Test Distance:9.000m [K=1.0000]  
Remarks: